


**SCHEMATIC DIAGRAM
METER & BREAKERS**

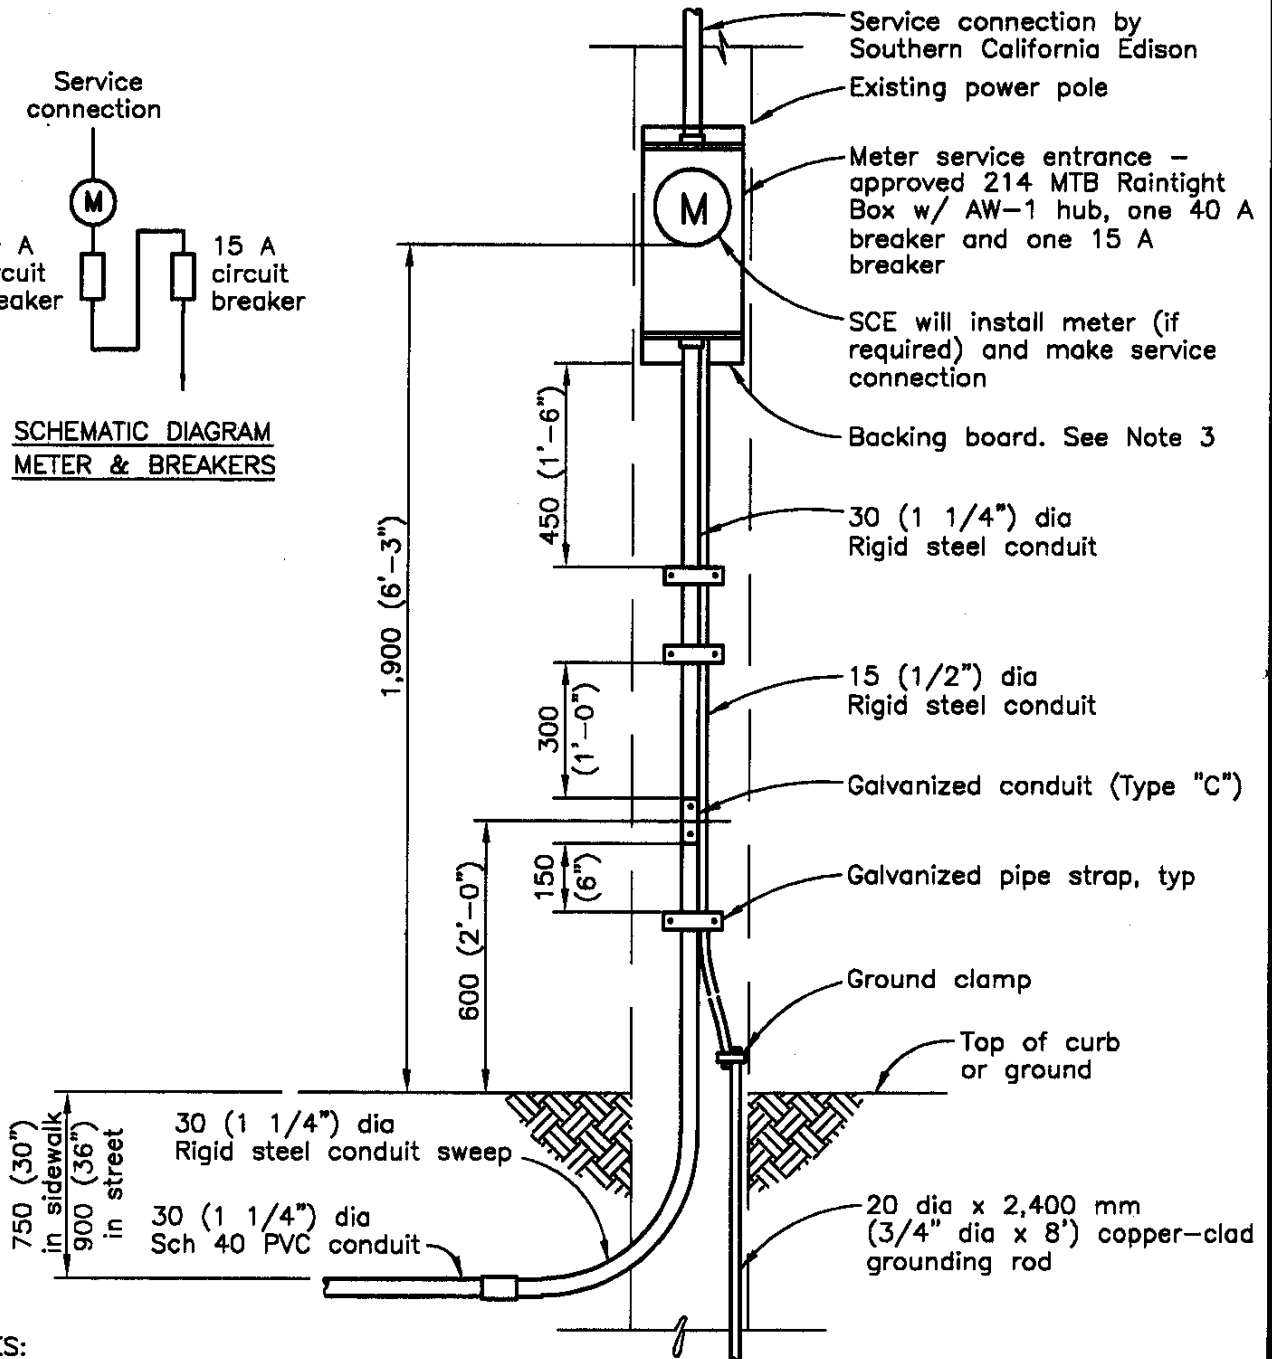

NOTES:

1. Pole service connection is intended for temporary service and shall be installed only when specified.
2. Contractor shall notify City Light and Power at (562) 483-2000 48 hours before installing any conduit.
3. Backing board shall be 20 mm (3/4") redwood with 20 x 40 mm (3/4" x 1 1/2") redwood cleats top and bottom. Fasten board to pole with four 16d galvanized nails. Paint board with two coats of exterior green enamel on all sides.

Dimensions are in millimeters, except as noted

REVISIONS		CITY OF LONG BEACH, CALIFORNIA DEPARTMENT OF PUBLIC WORKS	STANDARD PLAN NO.
NO.	DATE		METRIC 711
1	01/22/98	POWER POLE SERVICE CONNECTION	SHEET
2	12/23/02		1 OF 1
3			
4			
APPROVED BY: <i>Mark Cristofalo</i>		DATE: <i>1/10/03</i>	
CITY ENGINEER R.E. No. <i>40699</i>		EX. DATE: <i>03/31/03</i>	