



INFORMATION BULLETIN

IB-014

Eff: 1-23-2008 Rev: 12-06-2023

Asphalt Shingles Roof Coverings and Reroofing

The purpose of this information bulletin is to assist owners and contractors understand what are the applicable building code provisions that govern the proper installation of asphalt shingles roof coverings and reroofing.

ROOF COVERINGS

Roof coverings shall be applied in accordance with the applicable provisions of the 2019 California Building Code (CBC) §1507, the 2019 California Residential Code (CRC) §R905, and the manufacturer's installation instructions. The installation of asphalt shingles roof coverings shall comply as follows:

- **Deck Requirements** – Asphalt shingles shall be fastened to solidly sheathed decks. (CBC §1507.2.1 & CRC §R905.2.1)
- **Slope** – Asphalt shingles shall only be used on roof slopes of 2 units vertical in 12 units horizontal (17% slope) or greater. For roof slopes from 2 units vertical in 12 units horizontal (17% slope) up to 4 units vertical in 12 units horizontal (33% slope), double underlayment application is required in accordance with CBC §1507.2.8. (CBC §1507.2.2 & CRC §R905.2.2)
- **Underlayment** – For projects under the 2019 California Building Code, underlayment shall comply with Section 1507.1.1. For projects under the 2019 California Residential Code, underlayment shall comply with Section R905.1.1. (CBC §1507.2.3 & CRC §R905.2.3)
- **Asphalt Shingles** – Asphalt shingles shall comply with ASTM D 3462. Asphalt shingle packaging shall bear labeling indicating compliance with ASTM D 7158 and the required classification in Table R905.2.4.1. (CBC §1507.2.4 & CRC §R905.2.4.1). Asphalt shingles not included in the scope of ASTM D7158 shall be tested and labeled to indicate compliance with ASTM D3161 and the required classification in Table R905.2.4.1.
- **Fasteners** – Fasteners for asphalt shingles shall be galvanized, stainless steel, aluminum or copper roofing nails, minimum 12 gage shank with a minimum 0.375 inch-diameter head, of a length to penetrate through the roofing materials and a minimum of 0.75 inch into the roof sheathing. Where the roof sheathing is less than 0.75 inch thick, the nails shall penetrate through the sheathing. Fasteners shall comply with ASTM F 1667. (CBC §1507.2.5 & CRC §R905.2.5)
- **Attachment** – Asphalt shingles shall have the minimum number of fasteners required by the manufacturer and CBC Section 1504.1. Asphalt shingles shall be secured to the roof with not less than 4 fasteners per strip shingle or 2 fasteners per individual shingle. Where the roof slope exceeds 21 units vertical in 12 units horizontal (175% slope), asphalt shingles shall be installed in accordance with the manufacturer's printed installation instructions for steep-slope roof applications. (CBC §1507.2.6 & CRC §R905.2.6)

- Underlayment Application** – For roof slopes from 2 units vertical in 12 units horizontal (17% slope) and up to 4 units vertical in 12 units horizontal (33% slope), underlayment shall be 2 layers applied in the following manner. Apply a minimum 19-inch-wide strip of underlayment felt parallel with and starting at the eaves, fastened sufficiently to hold in place. Starting at the eave, apply 36-inch-wide sheets of underlayment overlapping successive sheets 19 inches, by fastened sufficiently to hold in place. Distortions in the underlayment shall not interfere with the ability of the shingles to seal. For roof slopes of 4 units vertical in 12 units horizontal (33% slope) or greater, underlayment shall be one layer applied in the following manner. Underlayment shall be applied shingle fashion, parallel to and starting from the eave and lapped 2 inches, fastened sufficiently to hold in place. Distortions in the underlayment shall not interfere with the ability of the shingles to seal. (CRC §R905.1.1, & Table R905.1.1(2))

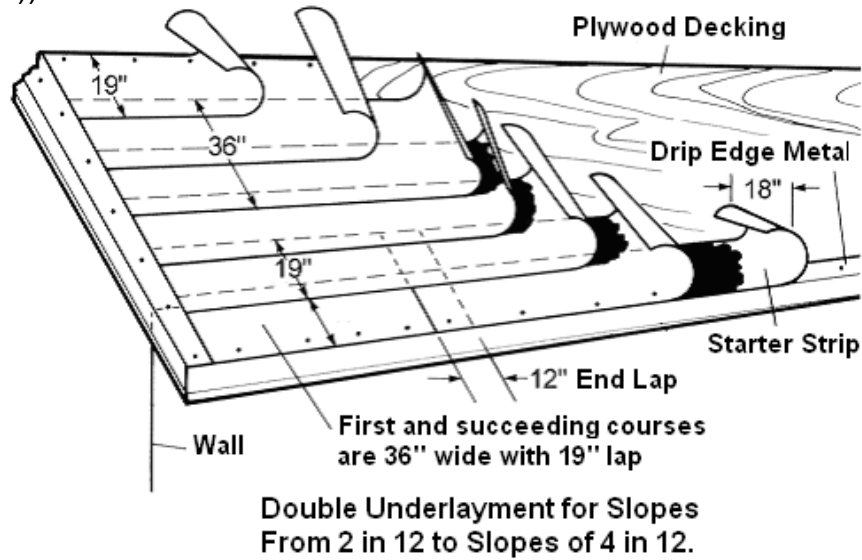


FIGURE 1

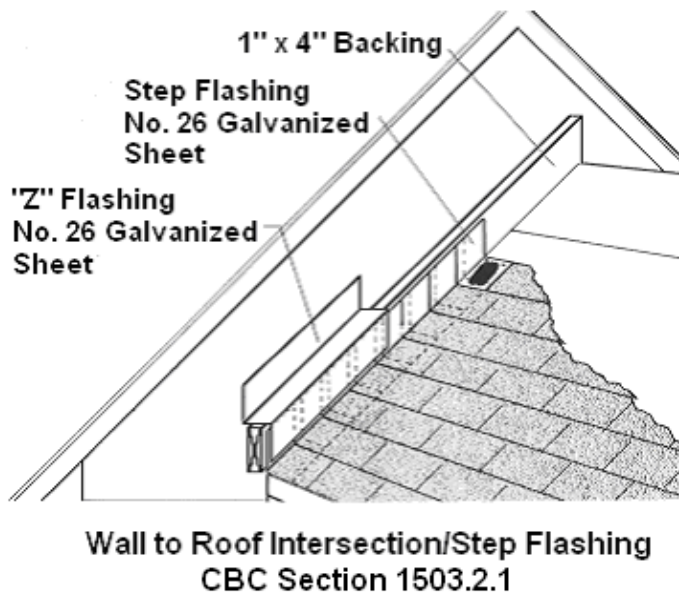


FIGURE 2

- **Valleys** – Valley linings shall be installed in accordance with the manufacturer’s instructions before applying shingles. Valley linings of the following types shall be permitted: (CBC §1507.2.8.2 & CRC §R905.2.8.2)
 1. For open valleys (valley lining exposed) lined with metal, the valley lining shall be at least 24 inches (610 mm) wide and of any of the corrosion-resistant metals in CBC Table 1507.2.8.2 & CRC Table R905.2.8.2.
 2. For open valleys, valley lining of 2 plies of mineral-surfaced roll roofing complying with ASTM D 3909 or ASTM D 6380 shall be permitted. The bottom layer shall be 18 inches (457 mm) and the top layer a minimum of 36 inches (914 mm) wide.
 3. For closed valleys (valleys covered with shingles), valley lining of one ply of smooth roll roofing complying with ASTM D 6380, and at least 36 inches (914 mm) wide or types as described in Items 1 and 2 above shall be permitted. Specialty underlayment shall comply with ASTM D 1970.

**CBC Table 1507.2.8.2 & CRC Table R905.2.8.2
VALLEY LINING MATERIAL**

<i>Material</i>	Minimum Thickness	Gage	Weight
Aluminum	0.024 in.	--	--
Cold-rolled copper	0.0216 in.	--	ASTM B 370, 16 oz. per square ft.
Copper	--	--	16 oz
Galvanized steel	0.0179 in.	26 (zinc-coated G90)	--
High-yield copper	0.0162 in.	--	ASTM B 370, 12 oz. per square ft.
Lead	--	--	2.5 pounds
Lead-coated copper	0.0216 in.	--	ASTM B 101, 16 oz. per square ft.
Lead-coated high-yield copper	0.0162 in.	--	ASTM B 101, 12 oz. per square ft.
Painted terne	--	--	20 pounds
Stainless steel	--	28	--
Zinc alloy	0.027 in.	--	--


- **Drip edge** – Provide drip edge at eaves and rake edges of shingle roofs. Overlap to be a minimum of 2 inches (51 mm). Eave drip edges shall extend 0.25 inch below sheathing and extend back on the roof a minimum of 2 inches (51 mm). Drip edge shall be mechanically fastened a maximum of 12 inches (305 mm) o.c. (CBC §1507.2.8.3 & CRC §R905.2.8.5)

REROOFING

Material and methods of application used for recovering or replacing an existing roof covering shall comply with the requirements of the 2019 CBC §1511 & CRC §R908. Structural roof components shall be capable of supporting the roof-covering system and the material and equipment loads that will be encountered during installation of the system.

- **Recovering versus replacement** – New roof coverings shall not be installed without first removing all existing layers of roof coverings where any of the following conditions occur: (CBC §1511 & CRC §R908)

1. Where the existing roof or roof covering is water soaked or has deteriorated to the point that the existing roof or roof covering is not adequate as a base for additional roofing.
2. Where the existing roof covering is slate, clay, cement, or asbestos-cement tile.
3. Where the existing roof has 2 or more applications of any type of roof covering.

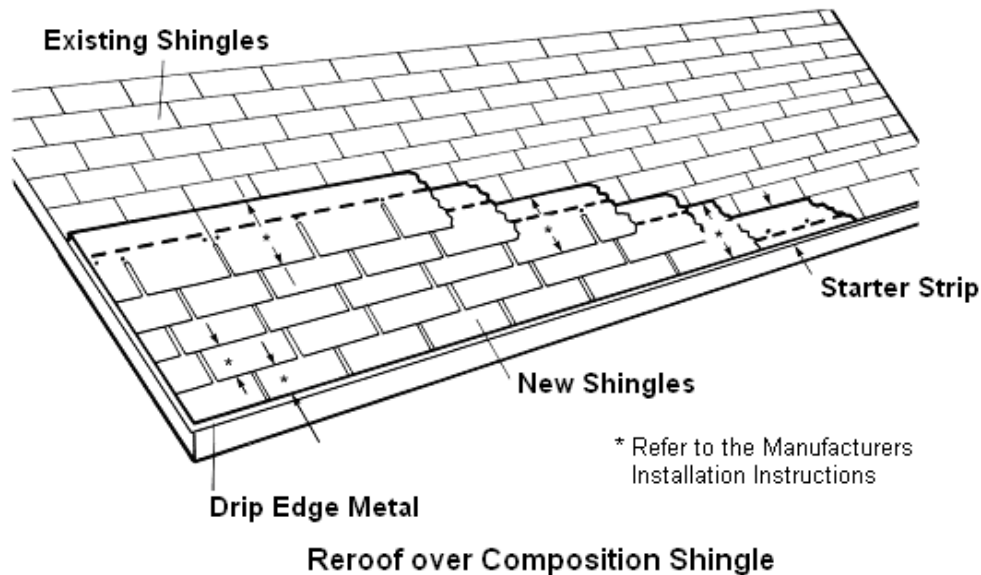**FIGURE 3**

To request this information in an alternative format or to request a reasonable accommodation, please contact the Community Development Department at longbeach.gov/lbcd and 562.570.3807. A minimum of three business days is requested to ensure availability; attempts will be made to accommodate requests with shorter notice.